

Application Received  
Stamp

**Elsinore Valley Municipal Water District**  
P.O. Box 3000, 31315 Chaney St, Lake Elsinore, CA 92531  
O: (951) 674-3146; F: (951) 346-3352 email: ihaveavoice@evmwd.net

Account # \_\_\_\_\_

Meter # \_\_\_\_\_

### Application for Hydrant Meter Service

**Requirements of Use:** \_\_\_\_\_ Customer initials acknowledging understanding of below requirements.

- ❖ A deposit, paid in advance, is required for hydrant meter service (\$1,500.00 for 3" meter, \$2,000.00 for 6" meter)
- ❖ Business card required for company representatives.
- ❖ The District's Customer Service Dept. must be **notified in writing** to discontinue service and prevent further billing.
- ❖ Applicant is responsible for flagging hydrant where meter will be used. **Meters will not be set without flagging.**
- ❖ Payment is due no later than **21 days** from the date of the bill. Meter is subject to removal if payment is not received by indicated due date and will be charged a **\$45.00 RECONNECTION FEE.**
- ❖ Applicant will be charged for replacement meter or repairs in the event the meter is damaged, stolen or lost.
- ❖ Drawing water from a District hydrant or wharf head without the use of a meter will result in a **\$750 fine per incident** that is assessed without warning and is non-refundable.
- ❖ Billing charges include water consumption, power zone charges and a \$5.00 per day service charge.
- ❖ Only District staff are authorized to move hydrant meters. If relocation is required, then applicant will notify the District in writing at least 24 hours in advance. Notification will include issued account or meter number. There is a **\$100.00 fee** charged for each move.
- ❖ An **Unauthorized Use fine of \$150.00** will be assessed for unauthorized removal of the meter or tampering with the meter or locking device.
- ❖ Customer will be responsible for Backflow Assembly if required by District (see attached Backflow requirements).
- ❖ Hydrant meters will be removed if unprotected cross-connections are found, if required Backflow device is not used, or if meter is used in any manner that may prove harmful to District.
- ❖ Monthly meter reads for floater meters must be submitted to Customer Service **no later than the 1<sup>st</sup> Monday of each month.** Failure to report monthly meter reads will result in additional charges.

Today's Date: \_\_\_\_\_ Desired Service Start Date (Please allow 5 business days for meter installation): \_\_\_\_\_

Hydrant Location: \_\_\_\_\_ City: \_\_\_\_\_ Zip Code: \_\_\_\_\_  
*(Street Address or Closest Intersection)*

Applicant/Primary Contact Name: \_\_\_\_\_ Company: \_\_\_\_\_

Title: \_\_\_\_\_ Office Phone: (\_\_\_\_\_) \_\_\_\_\_ Cell Phone: (\_\_\_\_\_) \_\_\_\_\_

Billing Address: \_\_\_\_\_ City: \_\_\_\_\_ State: \_\_\_\_\_ Zip Code: \_\_\_\_\_  
*(Street Address)*

DL #: \_\_\_\_\_ DL State: \_\_\_\_\_ Federal Tax ID #: \_\_\_\_\_ Email: \_\_\_\_\_

**Describe in detail how water from the hydrant will be used:**

Duration of use in days: \_\_\_\_\_ Estimated usage per day (gallons): \_\_\_\_\_ Gallons per minute (if over 50k gallons): \_\_\_\_\_

How will water be distributed (Check all that apply. First 2 selections require functioning & approved air gap separation):

Water Truck     To Water Tank     Applied Directly from Hydrant Via Hose (If so, hose is approximately \_\_\_\_\_ ft. long)

Other (please describe in detail): \_\_\_\_\_

The undersigned applicant accepts responsibility for payment of all charges for water services provided by the Elsinore Valley Municipal Water District and agrees to comply with all District regulations governing such services as outlined in the District's Administrative Code.



Signature: \_\_\_\_\_ Date: \_\_\_\_\_

**Office Use Only:**




Approvals:	Initials	Date	Comments
Operations:	_____	_____	_____
Backflow:	_____	_____	_____

Engineering MGR Signature \_\_\_\_\_ GM (Floating Only): \_\_\_\_\_  Approved  Denied

Acceptable Methods and Installation of Backflow Protection for Hydrant-Meter Use

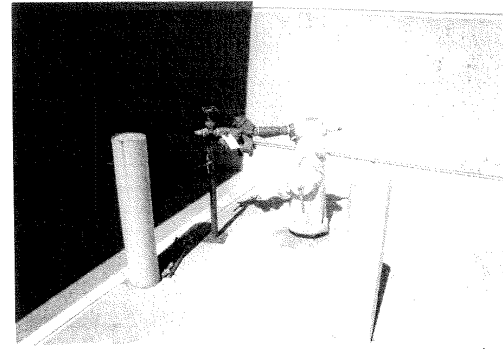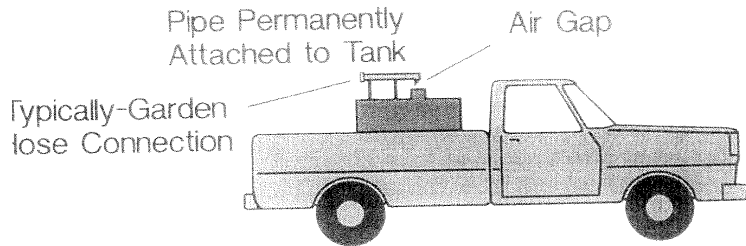


Please notice support on end of backflow device.

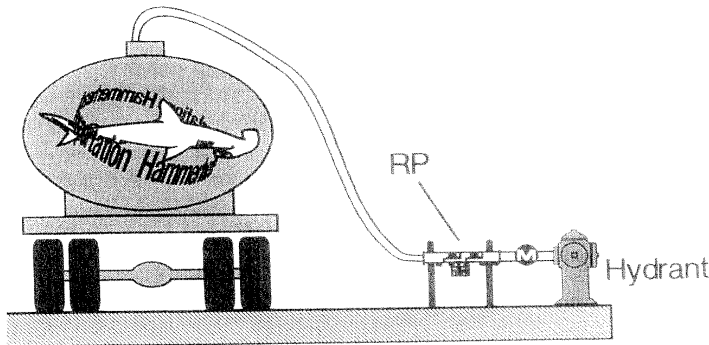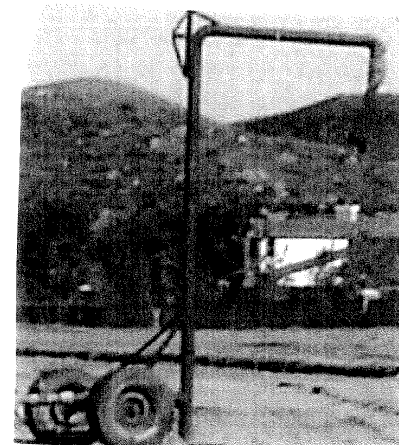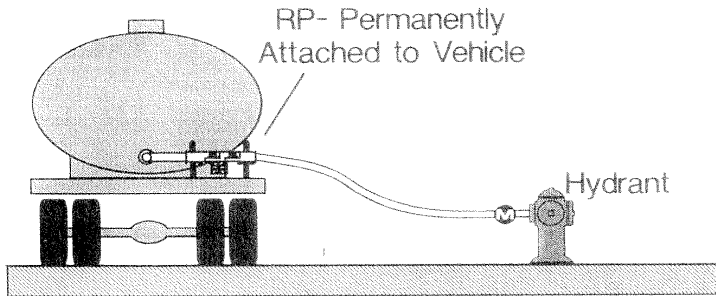

Examples of use that may require,  
Backflow Device

- 1.If water is to be directly applied with hose.
- 2.Use of hose longer than 50'
- 3.Hard Piping (Pressurized System)

There are a number of factors to consider, so if you have any questions "Please Call" thank you.

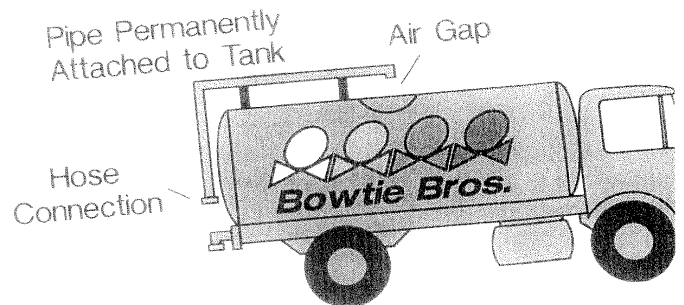

Please contact the Backflow Department at  
951-674-3146, ext. 8314 for further questions or clarification  
of requirements.