



**PARALLEL
CONSTRUCTION**

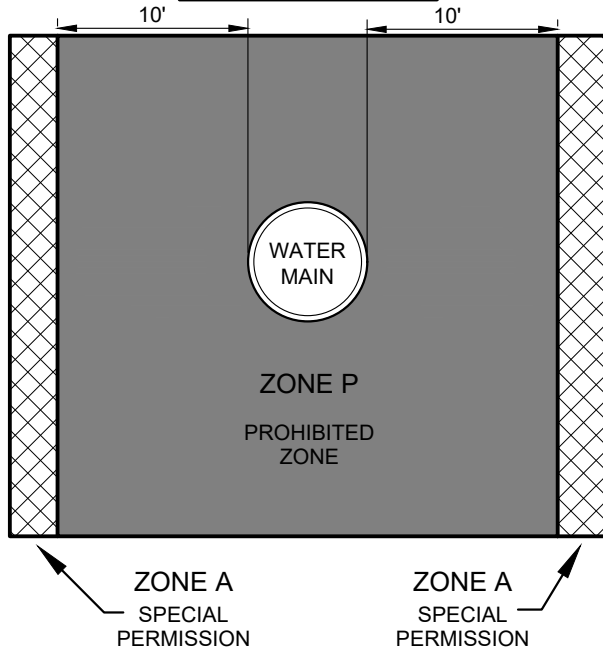

**PERPENDICULAR
CONSTRUCTION**

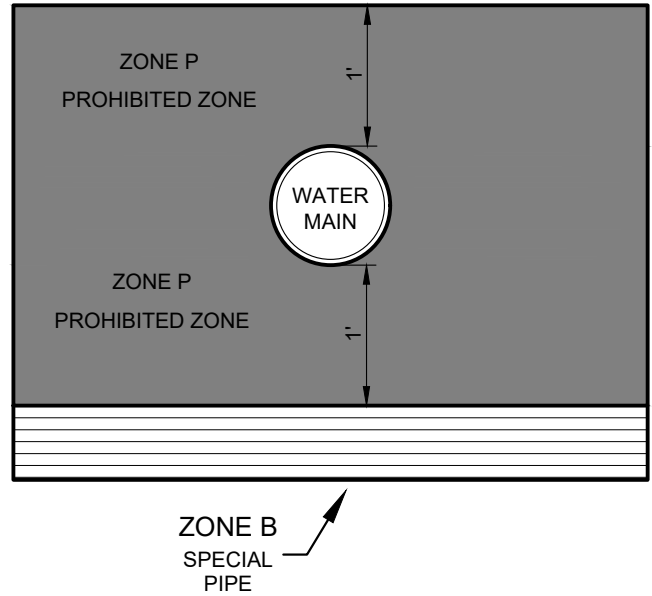

NOTES:


- SEWER MAINS ARE NOT PERMITTED WITHIN THE PROHIBITED ZONE UNLESS APPROVED BY THE STATE WATER RESOURCE CONTROL BOARD (STATE BOARD). IF APPROVAL IS REQUIRED, THE ENGINEER OF RECORD SHALL SUBMIT A WATERWORKS STANDARDS MAIN SEPARATION ALTERNATIVE REQUEST CHECKLIST TO THE DISTRICT. THE DISTRICT WILL COORDINATE THE APPROVAL WITH THE STATE BOARD ON THE DEVELOPER'S BEHALF.
- SEPARATION OF WATER MAIN FROM SEWER AND OTHER NON-POTABLE FLUID MAINS SHALL BE IN ACCORDANCE WITH CALIFORNIA CODE OF REGULATIONS (CCR), TITLE 22, DIVISION 4, CHAPTER 16, SECTION 64572 OR RECENT UPDATE.
- DIMENSIONS ARE FROM OUTSIDE OF WATER MAIN TO OUTSIDE OF SEWER OR NON-POTABLE FLUID PIPELINES.

ZONE


WATER CONSTRUCTION REQUIREMENTS



PARALLEL SEWER MAINS SHALL BE CONSTRUCTED AT LEAST 10' HORIZONTAL FROM A WATERMAIN



SEWER MAINS SHALL BE CONSTRUCTED AT LEAST 1' VERTICAL AND NO LESS THAN 45-DEGREES BELOW A WATER MAIN. NO CONNECTION JOINTS ON THE WATER MAIN WITHIN 8 HORIZONTAL FEET FROM THE SEWER MAIN.



SEWER MAINS ARE PROHIBITED IN THIS ZONE UNLESS STATE BOARD WRITTEN APPROVAL IS OBTAINED.

REVISION	BY	APPR	DATE

ELSINORE VALLEY
MUNICIPAL WATER DISTRICT

Parag Kalaria
06/22/2023
PARAG KALARIA R.C.E. 83927 DATE

**PIPELINE SEPARATION
REQUIREMENTS**

STD. DWG. NO.
S-3