



**PARALLEL
CONSTRUCTION**

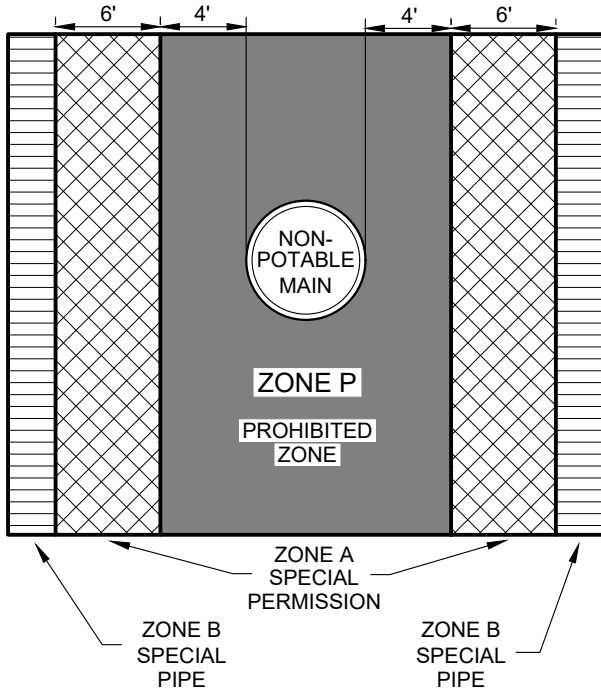

**PERPENDICULAR
CONSTRUCTION**

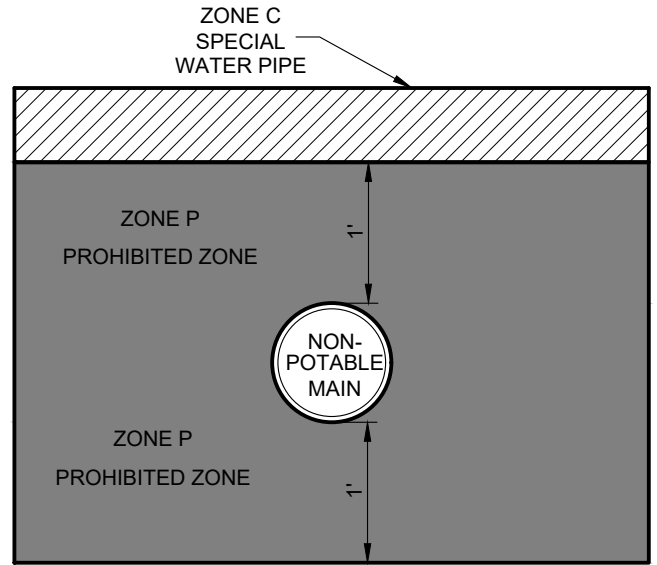

NOTES:


1. WATER MAINS ARE NOT PERMITTED WITHIN THE PROHIBITED ZONE UNLESS APPROVED BY THE STATE WATER RESOURCE CONTROL BOARD (STATE BOARD). IF APPROVAL IS REQUIRED, THE ENGINEER OF RECORD SHALL SUBMIT A WATERWORKS STANDARDS MAIN SEPARATION ALTERNATIVE REQUEST CHECKLIST TO THE DISTRICT. THE DISTRICT WILL COORDINATE THE APPROVAL WITH STATE BOARD ON THE DEVELOPER'S BEHALF.
2. SEPARATION OF WATER MAIN FROM SEWER AND OTHER NON-POTABLE FLUIDS SHALL BE IN ACCORDANCE WITH CALIFORNIA CODE OF REGULATION (CCR), TITLE 22, DIVISION 4, CHAPTER 16, SECTION 64572 OR MOST RECENT UPDATE.
3. DIMENSIONS ARE FROM OUTSIDE OF WATER MAIN TO OUTSIDE OF SEWER OR NON-POTABLE FLUID PIPELINES.

ZONE

SPECIAL SEWER CONSTRUCTION REQUIREMENTS



NO SANITARY SEWER MAINS PARALLEL TO WATER OR NON-POTABLE FLUID MAINS SHALL BE CONSTRUCTED WITHOUT PRIOR WRITTEN APPROVAL FROM THE CALIFORNIA DDW



SPECIAL SEWER PIPE - RUBBER GASKETED PVC SEWER PIPE (ASTM 3034) OR EQUIVALENT; OR HDPE PIPE WITH FUSION WELDED JOINTS.



NO JOINTS IN SEWER MAIN - SPECIAL SEWER PIPE MAY BE REQUIRED.



CONSTRUCTION PROHIBITED IN THIS AREA.

REVISION	BY	APPR	DATE

ELSINORE VALLEY
MUNICIPAL WATER DISTRICT

Parag Kalaria 06/22/2023
PARAG KALARIA R.C.E. 83927 DATE

**PIPELINE SEPARATION
REQUIREMENTS**

STD. DWG. NO.

W-2