


MAINTAIN 3' CLEARANCE ALL AROUND,  
AND NOT TO BE IN A SIDEWALK.

NOTE: NO TREES OR LARGE SHRUBS  
SHALL BE LOCATED WITHIN 10 FEET OF  
ALL PUBLIC WATER FACILITIES (PIPE,  
SERVICES, HYDRANTS, AIR/VACS, ETC.).

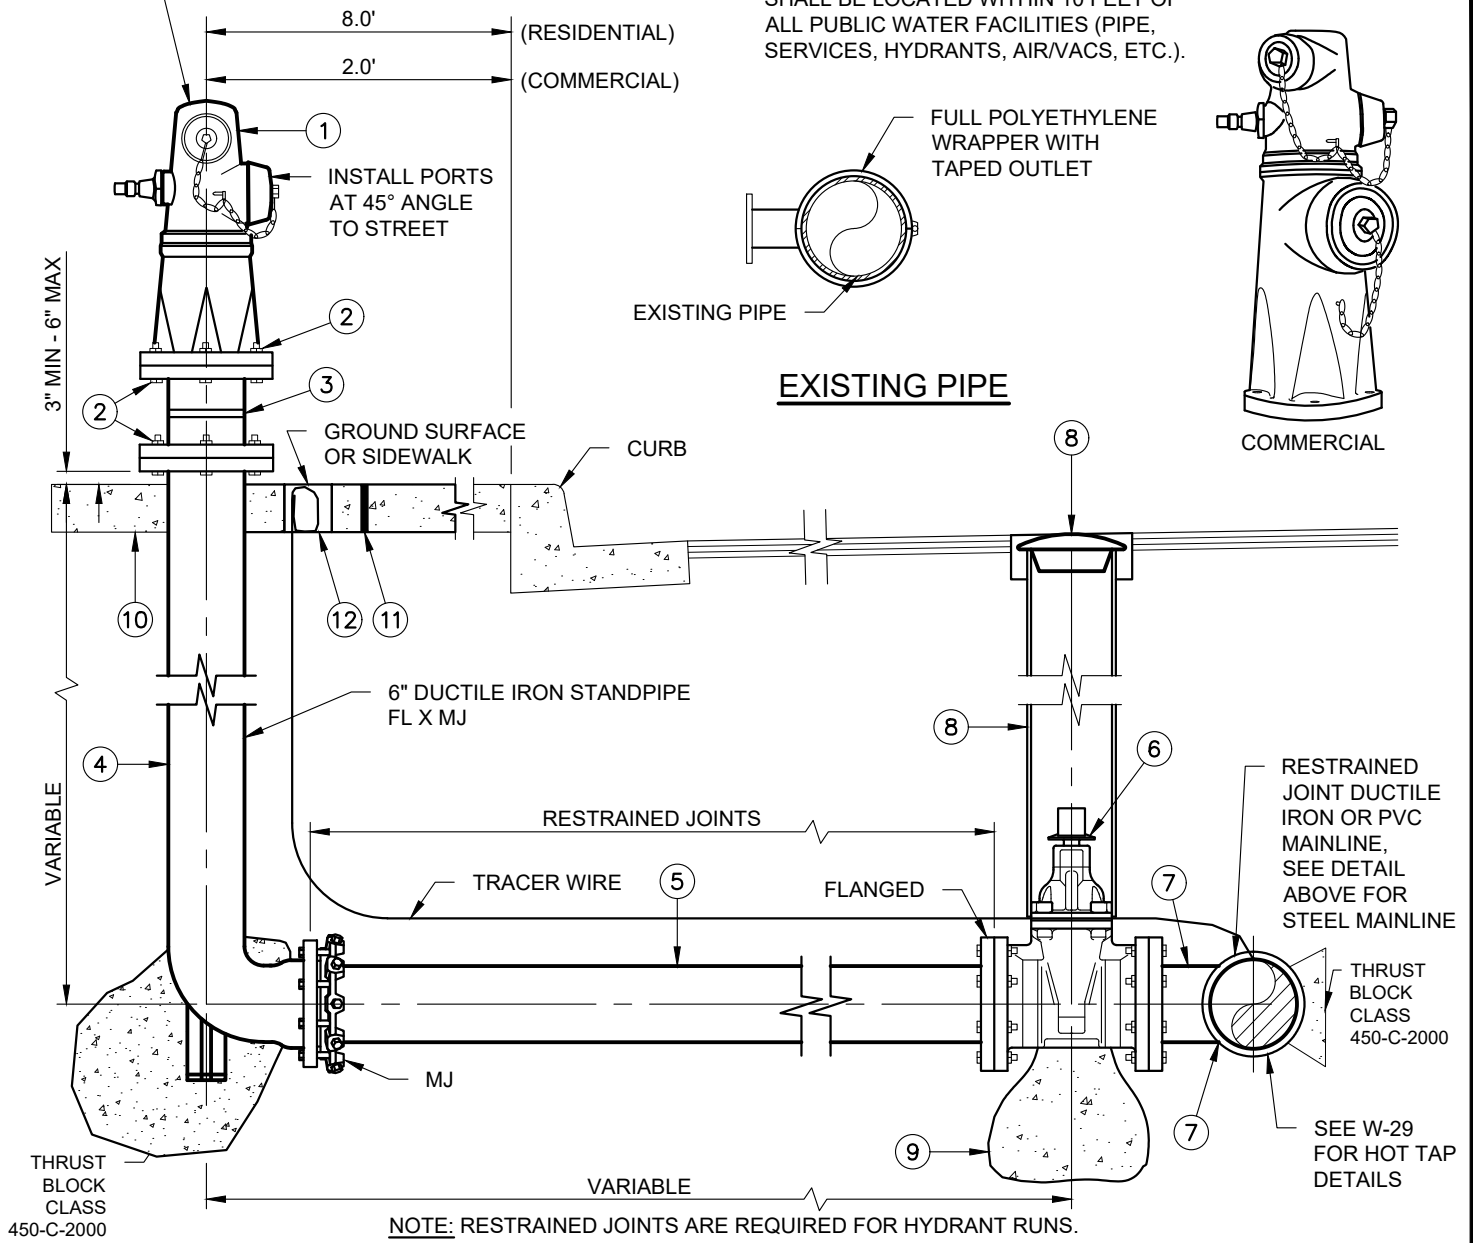

ITEM	EACH	DESCRIPTION	SPEC.	REMARKS
①	1	6" FIRE HYDRANT	2 OUTLET RES., 3 OUTLET COMMERCIAL	6 HOLE FL, SEE PAINT SPECS.
②	AS REQ'D	BOLTS WITH NUTS ON TOP OF FLANGE	5/8"x3" HEX HEAD ZINC PLATED W/ SOLID BODY	DUCTILE IRON HYDRANT.
③	1	GROOVED BREAK-OFF SPOOL	FLxFL, 6 HOLE, 6" OR 8"	SPOOL ABOVE SURFACE.
④	1	FIRE HYDRANT BURY	6 HOLES FLxMJ	VARIABLE HEIGHT.
⑤	1	6" HYDRANT RUN PIPE	DUCTILE IRON OR PVC C900	FLxPE OR FLxFL, CANNOT CROSS STREET C
⑥	1	6" RESILIENT WEDGE GATE VALVE	FLxFL	INCLUDES VALVE SUPPORT BLOCK
⑦	1	TEE W/ 6" OR 8" OUTLET	FL OUTLET	CUT IN TEE SIMILAR TO W-34 IF EXISTING MAIN
⑧	1	8" VALVE WELL, CAP AND SLIP CAN	STD. DWG. NO. W-13	
⑨	-	VALVE SUPPORT BLOCK	STD. DWG. NO. W-15	
⑩	1	3' X 3' X 6"THK CONCRETE SPLASH PAD	STANDARD SPEC SECTION 03310	CLASS 560-C-3250 CONCRETE
⑪	1	COLD JOINT STRIP	STANDARD SPEC SECTION 03310	
⑫	1	TRACER WIRE BOX	SEE APPROVED MATERIALS LIST	

REVISION	BY	APPR	DATE

06/22/2023  
PARAG KALARIA R.C.E. 83927 DATE

## FIRE HYDRANT / BLOW-OFF ASSEMBLY

STD. DWG. NO.  
**W-7A**