

\\len\businessdata\Share_F\ENGIN\6-CAD\Titleblock_Template\2024-08\EVMDW-CITY-ENGIN-With-CITY-TITLESWT.dwg

GENERAL NOTES

1. ALL WORK SHALL CONFORM TO THE ELSINORE VALLEY MUNICIPAL WATER DISTRICT (EVMWD) DESIGN AND CONSTRUCTION STANDARDS FOR WATER, RECYCLED WATER AND SANITARY SEWER FACILITIES.
2. CONSTRUCTION MATERIALS TESTING AND INSPECTION SHALL COMPLY WITH STANDARDS AND SPECIFICATIONS AND SHALL MEET OR EXCEED THE REQUIREMENTS OF THE GOVERNING AGENCY, THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION ("GREEN BOOK") AND THE AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM) STANDARDS. FAILURE TO MEET ANY OF THE ABOVE REQUIREMENTS SHALL BE CAUSE FOR REJECTION.
3. THE CONTRACTOR SHALL NOTIFY EVMWD (5) FIVE WORKING DAYS PRIOR TO BEGINNING WORK (951) 674-3146.
4. DEPTH AND LOCATION OF EXISTING UNDERGROUND FACILITIES SHALL BE DETERMINED BY THE CONTRACTOR BY POTHOLING AND A FIELD SURVEY OF ELEVATIONS AND SHALL BE GIVEN TO THE INSPECTOR PRIOR TO TRENCHING. THE CONTRACTOR SHALL ALSO CONTACT UNDERGROUND SERVICE ALERT (811) PRIOR TO ANY EXCAVATION WORK.
5. ALL CONSTRUCTION AND OPERATIONS BY THE CONTRACTOR SHALL BE IN ACCORDANCE WITH CAL-OSHA REQUIREMENTS.
6. THE CONTRACTOR SHALL KEEP A COMPLETE RECORD OF ALL CONSTRUCTION CHANGES AND SHALL MAKE INFORMATION AVAILABLE TO THE INSPECTOR FOR PREPARATION OF "AS BUILT" DRAWINGS. THE "AS BUILT" DRAWINGS SHALL BE SUBMITTED TO EVMWD FOR REVIEW PRIOR TO FINAL REVIEW AND ACCEPTANCE OF THE PROJECT.
7. WHERE THE WATER MAIN AND SEWER CROSS STORM DRAINS, OTHER PIPELINES, TELEPHONE AND ELECTRIC DUCTS, OR SIMILAR INSTALLATIONS, A MINIMUM OF 12 INCHES OF VERTICAL CLEARANCE SHALL BE PROVIDED BETWEEN THE MAIN OR SEWER AND OTHER INSTALLATIONS UNLESS OTHERWISE DIRECTED BY EVMWD PERSONNEL.
8. SEPARATION OF SEWER AND WATER LINES MUST COMPLY WITH EVMWD STANDARDS AND SHALL MEET OR EXCEED THE REQUIREMENTS OF THE STATE OF CALIFORNIA, DEPARTMENT OF PUBLIC HEALTH TITLE 22, CHAPTER 16, ARTICLE 4, SECTION 64572.
9. CONNECTIONS TO EXISTING EVMWD SEWER OR WATER LINES SHALL BE IN ACCORDANCE WITH STANDARD EVMWD PROCEDURES AND SHALL NOT BE MADE UNLESS EVMWD INSPECTOR IS PRESENT.
10. UNLESS WAIVED BY EVMWD AN INSULATED COPPER SOLID CORE 10 GAGE TRACER WIRE SHALL BE PLACED WITH EACH SEWER MAIN TO ASSIST WITH FUTURE LOCATION. WARNING TAPE SHALL BE PLACED AT LEAST 6" ABOVE SEWER MAIN & SEWER LATERALS, BUT NOT DEEPER THAN 24" BELOW THE EXISTING FINISHED GRADE. WATER MAINS SHALL ALSO HAVE TRACER WIRE AND WARNING TAPE INSTALLED IN THE TRENCH.
11. THE LENGTH OF OPEN TRENCH AT ANY ONE TIME SHALL BE LIMITED TO 600 FEET ALONG ROAD RIGHT-OF-WAY UNLESS OTHERWISE AGREED TO IN WRITING BY EVMWD. TRENCH SHALL BE BACKFILLED AND COMPACTED AT THE CONCLUSION OF EACH DAY. OPEN TRENCH LIMITS ARE SUBJECT TO CITY REQUIREMENTS.
12. SURFACE IMPROVEMENTS DAMAGED OR REMOVED AS A RESULT OF THE CONTRACTOR'S OPERATIONS SHALL BE RECONSTRUCTED BY THE CONTRACTOR TO THE LOCAL GOVERNING AGENCY'S REQUIREMENTS AT THE CONTRACTOR'S EXPENSE.
13. ALL REVISIONS TO THESE DRAWINGS MUST BE APPROVED BY EVMWD ENGINEERING MANAGER.
14. IT IS THE PROJECT ENGINEER'S RESPONSIBILITY TO TIE OUT ANY EXISTING STREET MONUMENTATION EITHER VISIBLE OR BURIED, PRIOR TO CONSTRUCTION.
15. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROTECT ANY STREET MONUMENTATION IN PLACE. IF ANY MONUMENT IS DISTURBED OR DESTROYED, THE CONTRACTOR WILL BE REQUIRED TO CONTRACT WITH A REGISTERED LAND SURVEYOR FOR THE RE-ESTABLISHMENT AND MAPPING OF THE DESTROYED MONUMENT AT THE CONTRACTOR'S EXPENSE.
16. THE EXISTENCE AND LOCATION OF ANY UNDERGROUND UTILITY PIPES OR STRUCTURES SHOWN ON THESE PLANS WERE OBTAINED BY A SEARCH OF THE AVAILABLE RECORDS. TO THE BEST OF EVMWD KNOWLEDGE THERE ARE NO EXISTING UTILITIES EXCEPT AS SHOWN ON THESE PLANS. THE CONTRACTOR IS REQUIRED TO TAKE DUE PRECAUTIONARY MEASURES TO PROTECT THE UTILITY LINES SHOWN AND ANY OTHER LINES NOT ON RECORD OR NOT SHOWN ON THESE PLANS OR MARKED ON THE GROUND BY UNDERGROUND SERVICE ALERT.
17. IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER OR CONTRACTOR TO APPLY FOR ANY NECESSARY ENCROACHMENT PERMIT FROM ALL GOVERNING AGENCIES.
18. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR/DEVELOPER TO STAMP A 2" HIGH "S", "W" OR "IW" ON THE CURB FACE FOR ALL SEWER, WATER, AND IRRIGATION LATERALS AT THE LOCATION WHERE THE LATERAL PASSES BENEATH THE CURB. A "V" SHALL BE STAMPED ON THE CURB FACE AT ALL VALVES.
19. A STEEL ROD OR STAKE 6" ABOVE THE GROUND OR 10 GAGE COPPER WIRE WITH 2" COPPER TAG, SHALL BE INSTALLED AT THE END OF EACH SEWER LATERAL TO ASSIST IN LOCATING AT A LATER DATE. IN NEW TRACT DEVELOPMENT A 3"x8" PVC PIPE OR 2"x4"x8' BOARD SHALL BE USED TO MARK THE ENDS OF LATERALS.
20. ALL SEWERS SHALL BE CLEANED WITH A HYDROJET/VACUUM COMBINATION TRUCK, AIR TESTED, MANDREL TESTED AND CCTV INSPECTED PRIOR TO ACCEPTANCE BY THE DISTRICT. AIR TEST, MANDREL TEST AND CLOSED CIRCUIT TELEVISION INSPECTION SHALL BE PER DISTRICT STANDARDS.
21. A PROPERTY LINE CLEANOUT WILL BE INSTALLED, 51/2" DEEP MINIMUM, OUTSIDE OF RIGHT- OF-WAY LINE, THE 1/8 BEND AND 45' WYE CONNECTION SHALL BE POLYVINYL CHLORIDE (PVC) OR ACRYLONITRILE BUTADIENE STYRENE (ABS).
22. PROTECT PIPE, JOINTS, LINING AND COATING, AND BED PIPE CAREFULLY TO PROVIDE CONTINUOUS BEARING AND PREVENT UNEVEN SETTLEMENT. PIPE SHALL BE PROTECTED AGAINST FLotation AT ALL TIMES. OPEN ENDS OF THE INSTALLED SEWER PIPE SHALL BE SEALED AT ALL TIMES WHEN CONSTRUCTION IS NOT IN PROGRESS.
23. PIPE JOINTS SHALL NOT BE DEFLECTED GREATER THAN 80% OF THE MAXIMUM ANGLE RECOMMENDED BY THE PIPE MANUFACTURER.
24. SEWER AND WATER PIPE TRENCH BACKFILL SHALL BE IN ACCORDANCE WITH EVMWD STANDARDS AND THE GOVERNING AGENCY. A FULL TIME SOILS TECHNICIAN MUST BE ONSITE DURING BACKFILLING AND COMPACTION.
25. ALL SERVICE LATERALS SHALL BE LOCATED AT RIGHT ANGLES TO THE MAIN UNLESS OTHERWISE INDICATED ON THE PLANS AND ACCEPTED BY EVMWD. MATERIALS FOR LATERALS SHALL MEET EVMWD SPECIFICATIONS. SEWER ELEVATIONS SHOWN ARE FLOWLINE (CONDUIT INVERT).
26. MINIMUM COVER FOR ALL WATER MAINS LESS THAN 12 INCHES IN DIAMETER SHALL BE 3.5 FEET. WATER MAINS 12 INCHES AND GREATER SHALL HAVE A MINIMUM COVER OF 4 FEET. MAXIMUM COVER FOR WATER MAINS SHALL BE 8 FEET, UNLESS ACCEPTED BY THE EVMWD ENGINEERING MANAGER.

EL SINORE VALLEY MUNICIPAL WATER DISTRICT

YOUR PROJECT NAME HERE
WATER AND/OR SEWER IMPROVEMENT PLANS
IN THE CITY OF XXX

GENERAL NOTES (CONT.)

27. VALVE CAN SHALL BE INSTALLED CENTERED ON VALVE NUT, PERPENDICULAR TO WATER MAIN. VALVES SHALL BE LOCATED SO THAT THERE WILL BE A MINIMUM CLEARANCE OF 6 INCHES BETWEEN THE TOP OF THE VALVE AND THE BOTTOM OF THE VALVE BOX COVER AT STREET SECTIONS.
28. THE MINIMUM CLEARANCE BETWEEN FIRE HYDRANTS AND UTILITY POLES, LIGHT STANDARDS AND SIGN POSTS SHALL BE 5 FEET.
29. NO WATER METER BOXES SHALL BE INSTALLED IN DRIVEWAYS OR SIDEWALKS. METER BOXES SHALL BE SET AT HIGH GRADE TO ELIMINATE WATER RUNOFF. INSTALL REDUCED PRESSURE PRINCIPLE OR BACK FLOW DEVICE AFTER IRRIGATION METER. INSTALL A PRESSURE REGULATOR ON HOMES OR BUSINESS IF THE PRESSURE IS OVER 80 PSI. A PRESSURE REGULATOR SHALL BE INSTALLED PRIOR TO ENTERING THE HOUSE/BUILDING PLUMBING.
30. ANY CHANGE IN FLOW DIRECTION (BENDS, TEES, FIRE HYDRANTS, ETC.) SHALL UTILIZE RESTRAINED DUCTILE IRON PIPE AND FITTINGS, IN LIEU OF THRUST BLOCKS.
31. AIR VALVES SHALL BE INSTALLED AT HIGH POINTS AND BLOWOFFS AT ALL LOW POINTS ON THE LINE AS PER EVMWD STANDARDS.
32. IF REQUIRED, A RESERVOIR AND BOOSTER PUMP STATION WILL HAVE TO BE CONSTRUCTED AND IN SERVICE BEFORE ANY SERVICE CAN BE PROVIDED TO THE UNITS CONSTRUCTED WITHIN THIS SUBDIVISION.
33. PRIOR TO PAVING THE STREET SECTION, ALL UNDERGROUND FACILITIES WITH LATERALS, INCLUDING BUT NOT LIMITED TO SEWER, WATER, TELEPHONE, ELECTRIC POWER, GAS, CABLE TELEVISION AND DRAINAGE FACILITIES SHALL BE IN PLACE, TESTED AND ACCEPTED BY THE RESPONSIBLE UTILITY/AGENCY.
34. HOUSE SLAB ELEVATIONS THAT ARE LOWER THAN THE UPSTREAM MANHOLE RIM ELEVATION SHALL BE EQUIPPED WITH BACKWATER VALVES. THE PROJECT ENGINEER SHALL INDICATE ON THE SEWER LATERAL TABLE WHICH LOTS ARE INVOLVED.
35. PRIOR TO THE CONSTRUCTION OF ANY BACKFLOW PROTECTION DEVICE, THE CONTRACTOR SHALL NOTIFY THE DISTRICT BACKFLOW ASSEMBLY INSPECTOR 24 HOURS PRIOR TO THE CONSTRUCTION OF ASSEMBLY. THE DISTRICT BACKFLOW INSPECTOR SHALL PROVIDE FINAL INSPECTION, TESTING AND ACCEPTANCE PRIOR TO TURNING ON THE WATER SUPPLY.
36. SURVEY STAKING FOR WATER PIPELINES IS AT 50-FOOT INTERVALS PLUS ALL APPURTENANCES, HORIZONTAL ALIGNMENT CHANGES AND VERTICAL ALIGNMENT CHANGES. SURVEY STAKING FOR SEWER PIPELINES IS AT 25-FOOT INTERVALS PLUS ALL LATERALS, MANHOLES IN AND OUT, APPURTENANCES, CLEANOUTS, HORIZONTAL & VERTICAL ALIGNMENT CHANGES, BEGINNING OF CURVES, AND END OF CURVES.
37. ALL WATER VALVES IN UNPAVED AREAS SHALL BE SURROUNDED BY AN ASPHALT PAD INSTALLED IN ACCORDANCE WITH EVMWD STANDARDS. A VALVE MARKER SHALL BE INSTALLED IN UNPAVED AREAS IN ACCORDANCE WITH EVMWD STANDARDS.
38. ALL MANHOLES INSTALLED IN UNPAVED AREAS SHALL BE SURROUNDED BY AN ASPHALT PAD INSTALLED IN ACCORDANCE WITH EVMWD STANDARDS.
39. ALL FACILITIES LOCATED DOWNSTREAM OF THE WATER METER AND FIRE DETECTOR CHECK METER ARE PRIVATE AND ARE TO BE MAINTAINED BY THE OWNER.
40. INTERIOR OF SEWER MANHOLES SHALL RECEIVE SPRAY-ON EPOXY COATING OR POLYURETHANE LINING. REFER TO ACCEPTED MATERIALS GUIDELINE LIST FOR APPROVED MANUFACTURER.

RECYCLED WATER GENERAL NOTES

1. FIVE (5) DAYS PRIOR TO COMMENCEMENT OF ANY EXCAVATION OF ON-SITE IMPROVEMENTS, THE CONTRACTOR SHALL NOTIFY THE ELSINORE VALLEY MUNICIPAL WATER DISTRICT ENGINEERING AND INSPECTION SECTION AT (951) 674-3146.
2. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE ELSINORE VALLEY MUNICIPAL WATER DISTRICT (EVMWD) "RULES AND REGULATIONS FOR RECYCLED WATER USE AND DISTRIBUTION WITHIN THE ELSINORE VALLEY MUNICIPAL WATER DISTRICT", AND THE STATE OF CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH) REQUIREMENTS.
3. CROSS CONNECTION BETWEEN RECYCLED WATER LINES AND POTABLE WATER LINES IS STRICTLY PROHIBITED.
4. NO SUBSTITUTION OF PIPE MATERIALS WILL BE ALLOWED WITHOUT PRIOR APPROVAL BY THE EVMWD AND CDPH.
5. ALL BELOW GRADE RECYCLED WATER PIPE SHALL BE COLOR CODE PURPLE PANTONE #522 OR DISTINCTIVELY WRAPPED WITH PURPLE TAPE AND STENCILLED WITH "CAUTION RECYCLED WATER - DO NOT DRINK". ORIENT THE STENCILING TO THE TOP OF THE TRENCH FOR LATERALS. INSTALL PURPLE METALLIC TAPE OVER THE RECYCLED WATER MAINS PER THE RECYCLED WATER SYSTEM STANDARD DESIGN REQUIREMENTS IN THE EVMWD STANDARD SPECIFICATIONS AND DRAWINGS.
6. ALL ABOVE GROUND RECYCLED WATER FACILITIES SHALL BE PURPLE COLORED PANTONE #512 AND MARKED TO DIFFERENTIATE RECYCLED WATER FACILITIES FROM POTABLE WATER OR WASTEWATER FACILITIES PER AMERICAN WATER WORKS ASSOCIATION (AWWA) GUIDELINES AND SECTION 116815 OF THE CALIFORNIA HEALTH AND SAFETY CODE.
7. PROVIDE A MINIMUM COVER OF ALL PIPES IN ACCORDANCE WITH EVMWD STANDARD SPECIFICATIONS AND DRAWINGS PER THE STANDARD DESIGN REQUIREMENTS FOR RECYCLED WATER PIPELINES.
8. MAINTAIN SEPARATION BETWEEN POTABLE WATER, RECYCLED WATER, AND/OR SEWER PIPELINES ACCORDING TO THE EVMWD STANDARD DRAWINGS AND CDPH GUIDANCE MEMO NO. 2003-02 LATEST REVISION.
9. ALL PUBLIC AND PRIVATE POTABLE WATER MAINS INCLUDING FIRE MAINS AND ANY WATER WELLS AND WATER COURSES WITHIN THE RECYCLED WATER PROJECT SHALL BE SHOWN ON THE PLANS.
10. TAG ALL VALVES AND OTHER BELOW GRADE FACILITIES WITHIN BOXES WITH PERMANENT RECYCLED WATER LABELS THAT IDENTIFY THE FACILITY AS "RECYCLED WATER - DO NOT DRINK NO BEBER". ATTACH THE LABEL WITH EITHER STAINLESS STEEL WIRE OR SELF-LOCKING PLASTIC TIES.

RECYCLED WATER GENERAL NOTES (CONT.)

11. BLOWOFF ASSEMBLIES FOR RECYCLED WATER SHALL BE IN ACCORDANCE WITH EVMWD STANDARDS.
12. ALL PUBLIC FACILITIES SUCH AS COMFORT STATIONS, DRINKING FOUNTAINS, OUTDOOR EATING AREAS, ETC. SHALL BE PROTECTED FROM SPRAY AND OR MISTING BY RECYCLED WATER.
13. NO PONDING, RUN-OFF, MISTING, OR OVER SPRAY IS PERMITTED. RELOCATE OR ADJUST ALL IRRIGATION HEADS TO PREVENT OVER SPRAYING ONTO SIDEWALKS, STREETS, PRIVATE LOTS, AND AREAS NOT APPROVED FOR RECYCLED WATER USE.
14. AREAS NOT APPROVED FOR RECYCLED WATER USE SHALL BE PROTECTED FROM CONTACT WITH RECYCLED WATER, WHETHER BY WINDBLOWN SPRAY OR BY DIRECT APPLICATION THROUGH IRRIGATION OR OTHER USE. LACK OF PROTECTION, WHETHER BY DESIGN, CONSTRUCTION PRACTICE, OR SYSTEM OPERATION IS STRICTLY PROHIBITED.
15. HOSE BIBS ON RECYCLED WATER SYSTEMS ARE PROHIBITED.
16. RECYCLED WATER QUICK COUPLING VALVES SHALL BE DESIGNED FOR USE ON RECYCLED WATER IN ACCORDANCE WITH THE RULES, AND REGULATIONS.
17. QUICK COUPLING VALVES USE IN RECYCLED WATER SYSTEMS SHALL CONFORM THE FOLLOWING:

17.1. QUICK COUPLING VALVES CAN BE 1 INCH OR 3/4 INCH NOMINAL SIZE. WITH BRASS CONSTRUCTION AND A NORMAL WORKING PRESSURE OF 150 PSI OR EQUAL.

17.2. A PURPLE RUBBER OR VINYL LOCKING COVER SHALL BE PERMANENTLY ATTACHED TO THE QUICK COUPLING VALVES.
18. WHEN POTABLE WATER AND RECYCLED WATER LINES CROSS, THE RECYCLED WATER LINE SHALL BE INSTALLED WITHIN A PROTECTIVE PIPE PER EVMWD STANDARDS. THE PROTECTIVE PIPE SHALL EXTEND 10 FEET FROM EACH SIDE OF THE OUTSIDE EDGE OF THE POTABLE WATER LINE.
19. PROVIDE A MINIMUM OF 12 INCHES OF VERTICAL SEPARATION BETWEEN POTABLE WATER, RECYCLED WATER, AND SEWER LINE ACCORDING TO THESE RULES AND CDPH. MAINTAIN AT LEAST 12 INCHES CROSSING SEPARATION BETWEEN OTHER UTILITIES UNLESS OTHERWISE DIRECTED BY EVMWD PERSONNEL.
20. INSTALL PURPLE COLORED PANTONE #512 MATERIAL FOR ALL ABOVE GRADE IRRIGATION FACILITIES PER AWWA GUIDELINES AND SECTION 116815 OF THE CALIFORNIA HEALTH AND SAFETY CODE.

20.1. VALVE AND OTHER ON - GRADE BOXES - PURPLE COLOR.

20.2. SPRINKLER HEADS - PURPLE COLOR.
21. ALL RECYCLED WATER SPRINKLER CONTROL VALVES AND OTHERS BELOW GRADE FACILITIES WITHIN BOXES SHALL BE TAGGED WITH IDENTIFICATION TAGS. TAGS SHALL BE WEATHER PROOF PLASTIC 3 INCHES X 4 INCHES, PURPLE IN COLOR, WITH WORDS "RECYCLED WATER - DO NOT DRINK" AND "AVISO AGUA IMPURA - NO TOMAR" IMPRINTED ON ONE SIDE, AND THE RECOGNIZED SYMBOL FOR NOT DRINKING ON THE OTHER SIDE. IMPRINTING SHALL BE PERMANENT AND BLACK IN COLOR. ONE TAG SHALL BE ATTACHED EITHER TO THE VALVE STEM DIRECTLY WITH PLASTIC TIE WRAP, OR TO THE SOLENOID WIRE DIRECTLY WITH PLASTIC TIE WRAP PER EVMWD STANDARDS.
22. THE CONTRACTOR SHALL CONDUCT A CROSS-CONNECTION CONTROL SHUTDOWN TEST AND COVERAGE TEST (AS DEFINED IN SECTION 4.8 OF THE DISTRICT'S RULES) WHEN REQUESTED BY THE DISTRICT OR CDPH PRIOR TO ANY USE OF RECYCLED WATER. THE METHOD OF THIS TEST MUST BE ACCEPTED BY THE DISTRICT.
23. THE REQUIRED CROSS-CONNECTION SHUTDOWN TEST MAY BE PERFORMED BY A CERTIFIED CROSS-CONNECTION CONTROL SPECIALIST AS DEFINED IN THE DISTRICT'S RULES AND WITNESSED BY THE DISTRICT'S CROSS-CONNECTION SPECIALIST. COPIES OF INSPECTION REPORTS SHALL BE FORWARDED TO THE DISTRICT.

ADDITIONAL RECYCLED WATER NOTES FOUND ON "GN-7 & GN-8"

WATER RIGHTS STATEMENT

AS A CONDITION OF SERVICE, THE APPLICANT SHALL EXECUTE A NOTARIZED GRANT DEED CONVEYING TO THE DISTRICT ALL RIGHTS TO WATER, INCLUDING SURFACE AND GROUNDWATER RIGHTS OVER, UPON AND UNDER THE PROPERTY AND WHICH ARE APPURTENANT THERETO OR ARE OTHERWISE ASSOCIATED WITH THE PROPERTY. THE DISTRICT SHALL PROVIDE THE APPLICANT WITH A GRANT DEED, THE GRANT DEED SHALL BE COMPLETED AND RETURNED TO THE DISTRICT, AND SHALL BE RECORDED WITH THE COUNTY RECORDER'S OFFICE.

RECORDED DOCUMENT # _____ - _____

NOTIFICATIONS

NOTE: THE CONTRACTOR SHALL NOTIFY THE FOLLOWING UTILITIES OR AGENCIES FORTY-EIGHT (48) HOURS PRIOR TO STARTING CONSTRUCTION OR EXCAVATION.

CITY OF LAKE ELSINORE

ELSINORE VALLEY MUNICIPAL WATER DISTRICT

XXX XX TELEPHONE

SOUTHERN CALIFORNIA GAS COMPANY

SOUTHERN CALIFORNIA EDISON COMPANY

XXX CABLE TV

UNDERGROUND SERVICE ALERT (U.S.A.)

1-951-XXX-XXXX

1-951-XXX-XXXX

1-800-XXX-XXXX

1-800-XXX-XXXX

1-800-XXX-XXXX

1-951-XXX-XXXX

1-800-227-2600

SHEET INDEX

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	INDEX MAP AND CONSTRUCTION NOTES
3	DRAWING NAME HERE
4	DRAWING NAME HERE
5	DRAWING NAME HERE
6	DRAWING NAME HERE
7	DRAWING NAME HERE
8	DRAWING NAME HERE
9	DRAWING NAME HERE
10	DRAWING NAME HERE

*IF VICINITY MAP DOES NOT FIT WITHIN THIS BORDER, THEN PUT ON SEPARATE SHEET.

VICINITY MAP

SCALE: 1"=2000'



TOWNSHIP: XXXX
RANGE: XXXX
SECTION: XXXX

NOTE TO CAD:

CHANGE INPUT VALUES OF THOSE ITEMS PLOTTED SCREENED AND ON LAYER "EV-INPUT_VALUES_TO_CHANGE" IN DIGITAL FILE. THIS NOTE IS FOR REFERENCE ONLY, PLEASE REMOVE THIS NOTE FROM FINAL PLANS.

ASSESSORS PARCEL NUMBER (APN)

INPUT ALL APNs ASSOCIATED WITH PROJECT HERE

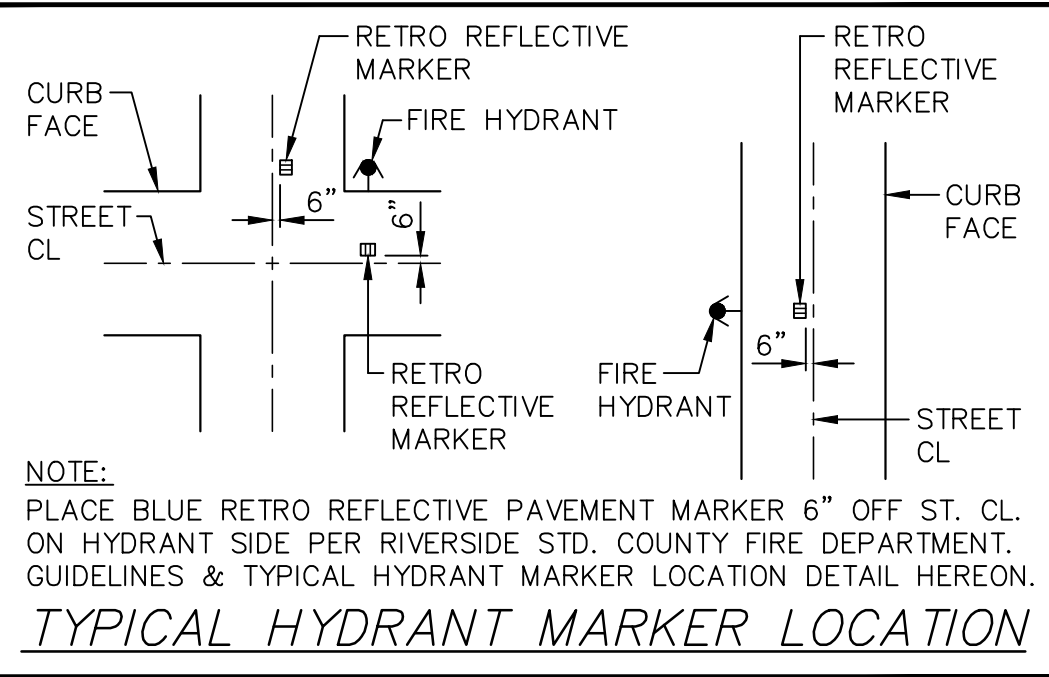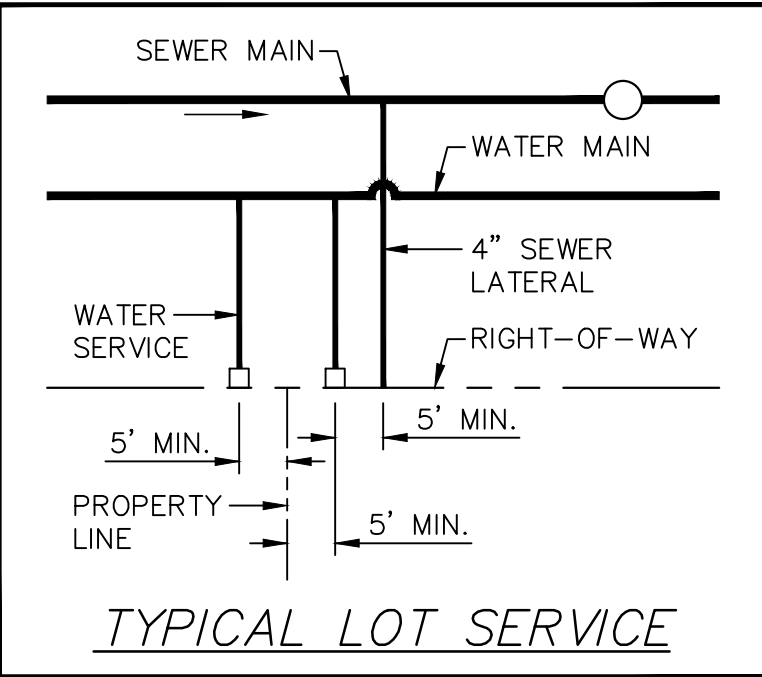

<div>Underground Service Alert</div> <div></div> <div>TWO WORKING DAYS BEFORE YOU DIG</div>			<div>THE DESIGN AND CONSTRUCTION OF THE PROJECT AS WELL AS THE ACCURACY OF FIGURES, ARE THE RESPONSIBILITY OF THE DESIGN ENGINEER. PLAN CHECK SERVICES BY E.V.M.W.D. WILL BE LIMITED TO ADHERENCE OF THE DISTRICT'S STANDARDS, MATERIALS, QUANTITIES AND SIZE OF FACILITIES, AS THEY RELATE TO THE SERVICE DEMANDS OR THE APPROVED MASTER PLAN.</div>			<div>RIVERSIDE COUNTY FIRE DEPARTMENT</div> <div>APPROVED BY: _____</div> <div>DATE: _____</div>			<div>I CERTIFY THAT THE DESIGN OF THE WATER SYSTEM IS IN ACCORDANCE WITH THE REQUIREMENTS PRESCRIBED BY THE RIVERSIDE COUNTY FIRE DEPARTMENT</div> <div>ENGINEER NAME HERE DATE</div>			<div>BENCHMARK</div> <div>ELEVATION: XX.XX</div> <div>DATE: XX.XX</div> <div>DATUM: NVDG29 OR NAVD88</div> <div>DESCRIPTION: XX.XX</div>			<div>VERIFY SCALES</div> <div>BAR IS ONE INCH ON ORIGINAL DRAWING</div> <div></div> <div>IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY</div>			<div>EXISTING UTILITY DISCLAIMER NOTE</div> <div>APPROVAL OF THIS PLAN BY THE ELSINORE VALLEY MUNICIPAL WATER DISTRICT DOES NOT CONSTITUTE A REPRESENTATION AS TO THE ACCURACY OF THE LOCATION OF, OR THE EXISTENCE OF, ANY UNDERGROUND UTILITY, PIPE, OR STRUCTURE WITHIN THE LIMITS OF THIS PROJECT.</div>			<div>OWNER/DEVELOPER</div> <div>COMPANY NAME HERE</div> <div>STREET ADDRESS HERE</div> <div>CITY LOCATION HERE</div> <div>CONTACT INFORMATION HERE</div>		
WATER/SEWER APPROVED BY: ELSINORE VALLEY MUNICIPAL WATER DISTRICT			REV BY DATE			REVISIONS			APPR. DATE			SHEET NO.											
ASSISTANT GENERAL MANAGER _____ DATE _____												1											
APPROVAL VALID FOR 2 YEARS FROM DATE SIGNED												OF X SHTS											
DEPARTMENT APPROVALS												FILE NO.											
												XX											
ENGINEERING			WATER			WASTEWATER			DESIGNED BY: XX			DRAWN BY: XX			CHECKED BY: XX								
												SUBMITTED BY: _____			PLANS PREPARED BY: _____								
												ENGINEER NAME HERE R.C.E. XXXXX EXP. X/X/XX			XX ENGINEERING COMPANY LOGO AND CONTACT INFORMATION GOES HERE XX								
												DATE: _____			P.Z.: XX								